


* SERVICE BOXES SHALL NOT BE INSTALLED IN SIDEWALKS OR DRIVEWAYS.
 12" FROM THE STREET SIDE OF THE SIDEWALK OR
 12" FROM THE LOT LINE IN ALLEYS OR WHERE NO SIDEWALK EXISTS

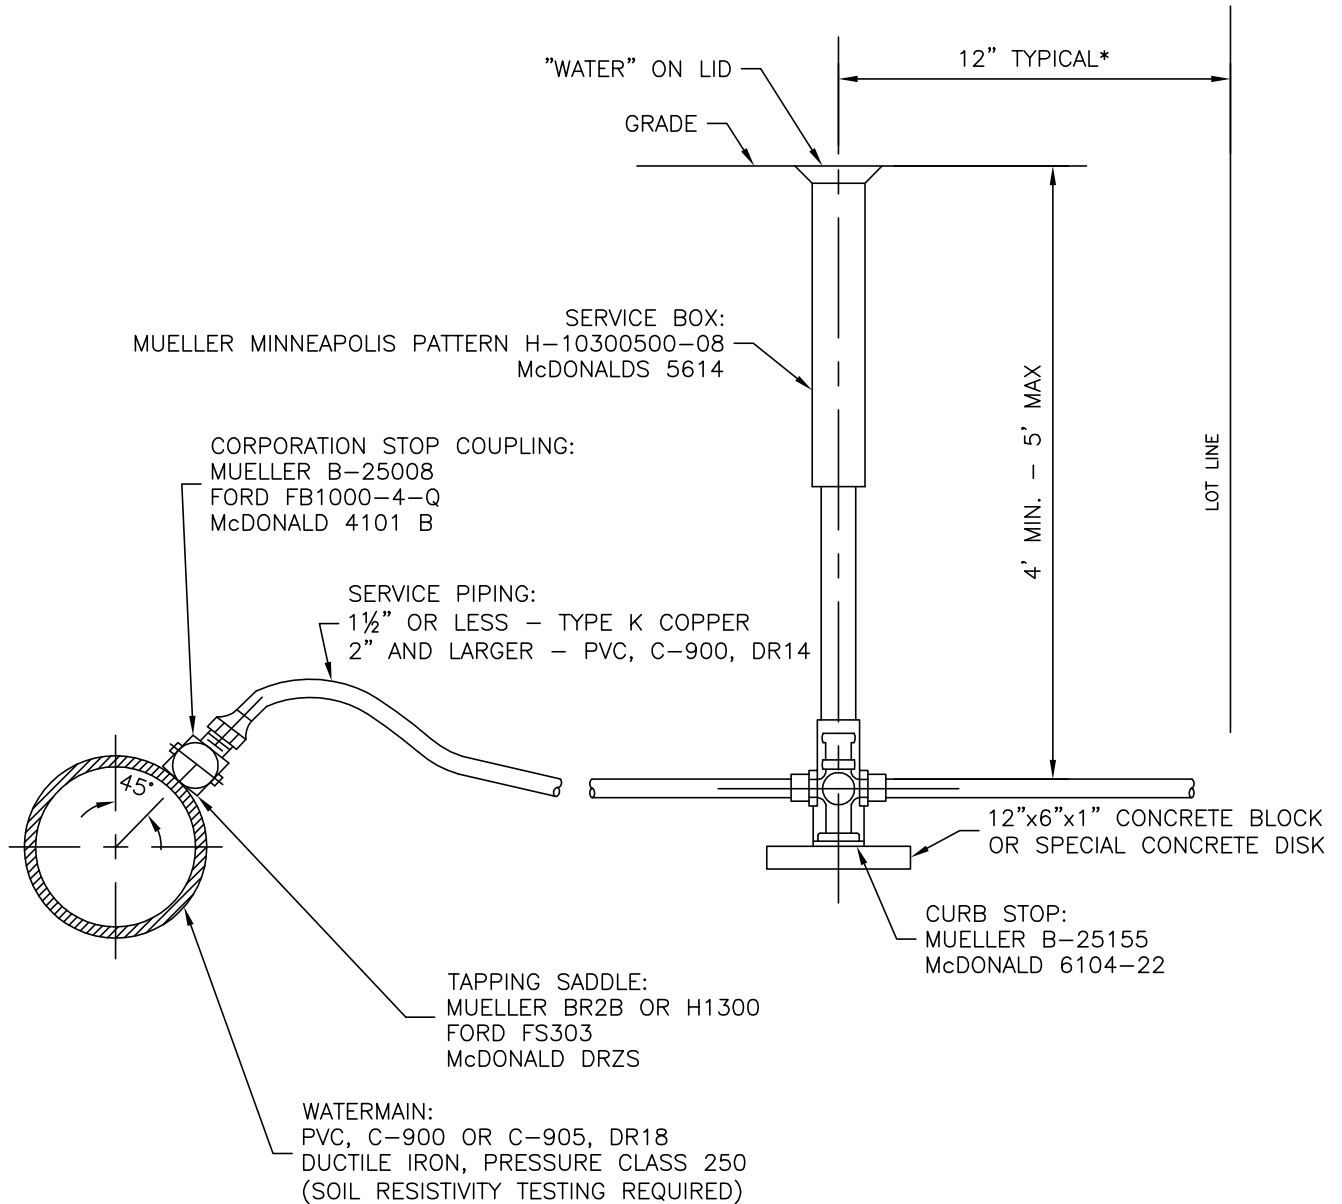

ALL MATERIALS TO BE MADE IN U.S.A.

**STANDARD
 TAP SERVICE
 PIPING (COPPER)**

BEDDING MATERIAL FOR COPPER PIPE:
 IDOT STD. FA-2 OR LAFARGE FM-02

CITY OF OTTAWA

DRG. 2

DECEMBER 15, 2008